



CB = CABLE BRACING

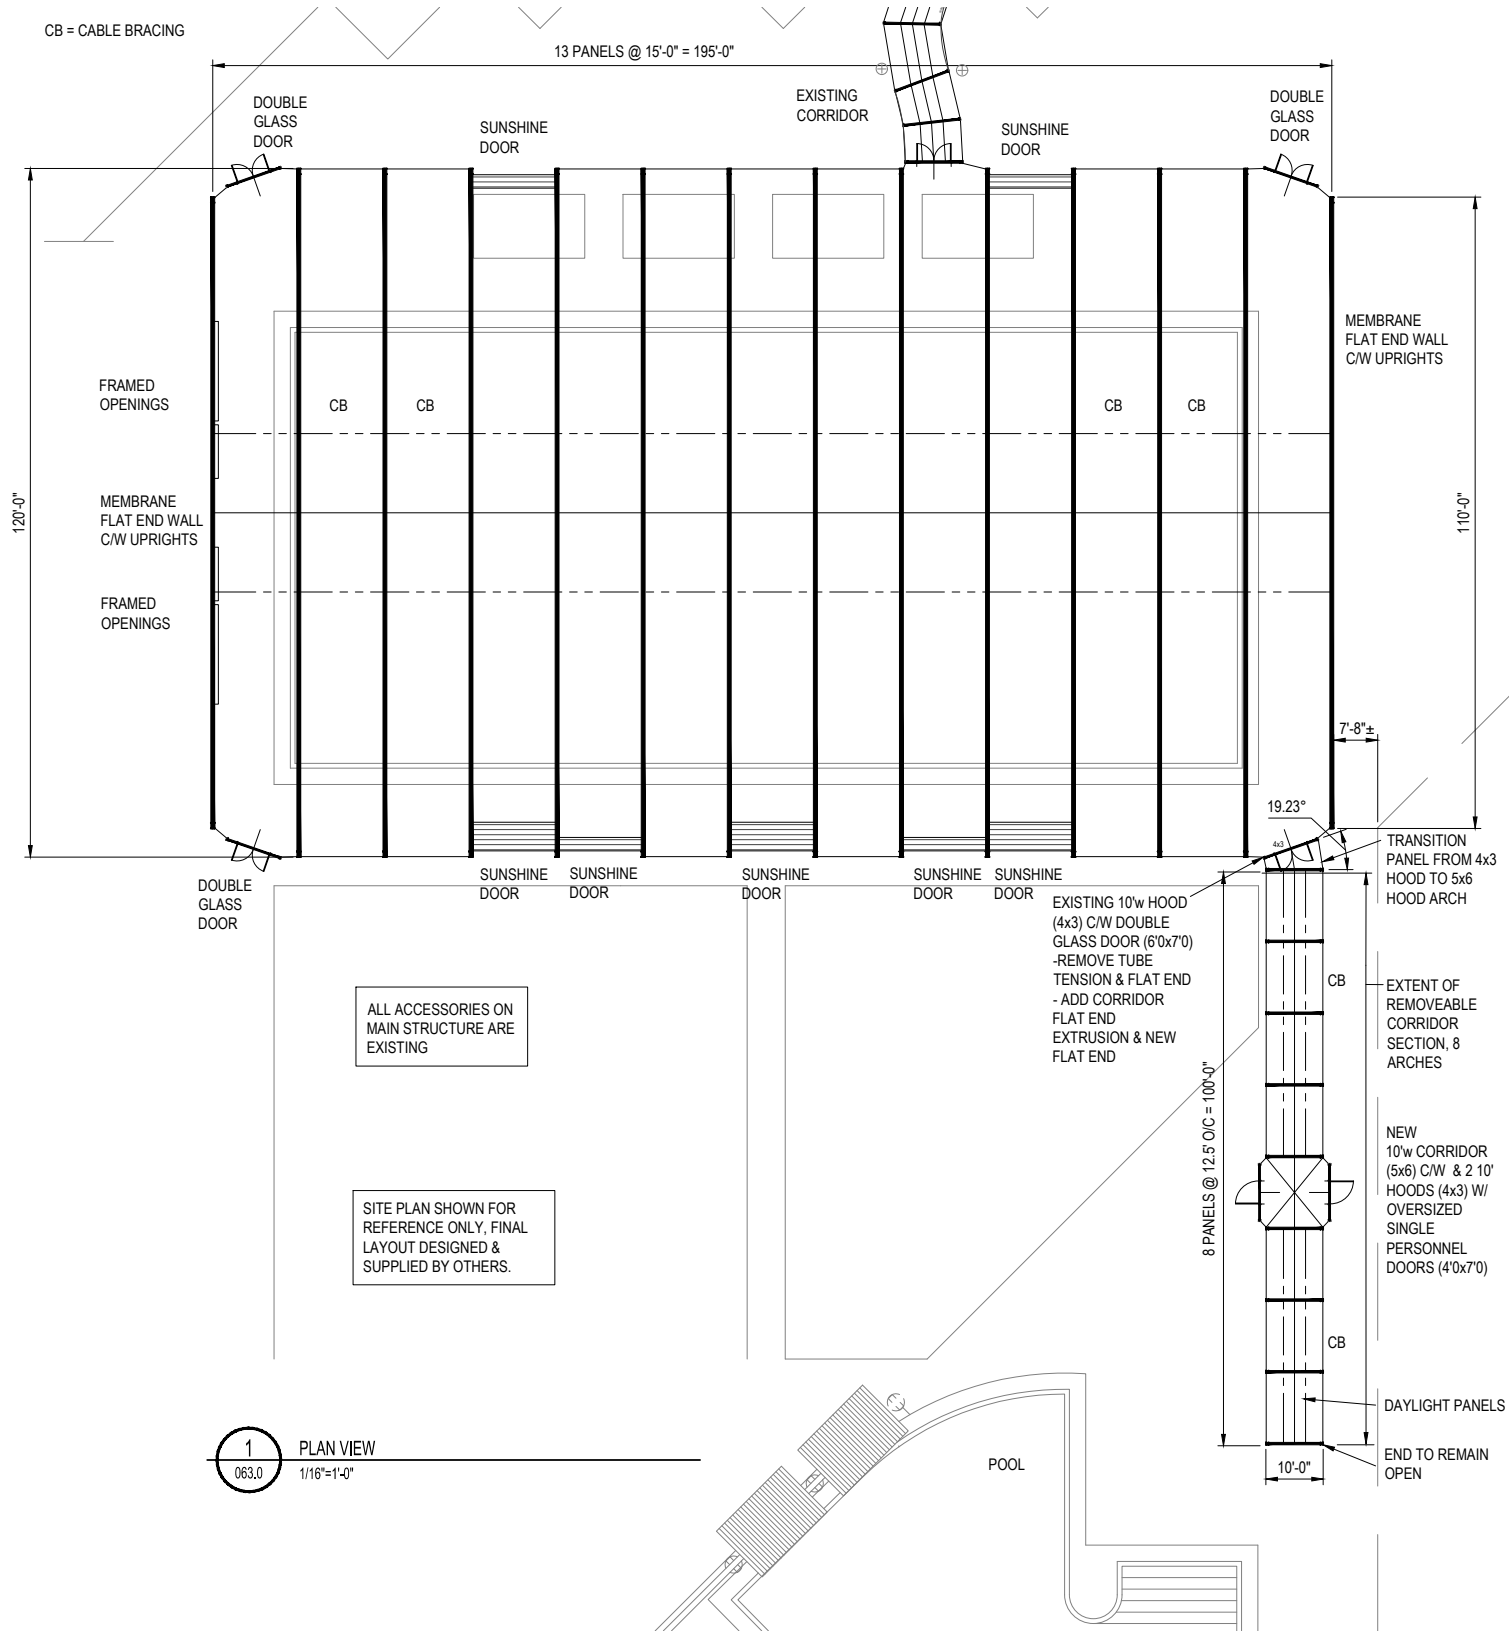


1 PLAN VIEW
063.0 1/16"=1'-0"


COLORS ON THESE ELEVATIONS MAY VARY SIGNIFICANTLY DEPENDING ON PRINTER OR MONITOR. PLEASE REFER TO MEMBRANE SAMPLES FOR ACTUAL COLORS.

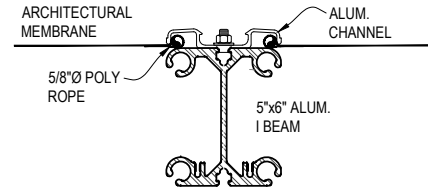


2 5"x6" NEW CORRIDOR BEAM SECTION W/ CHANNEL
063.0 3'-1'-0"

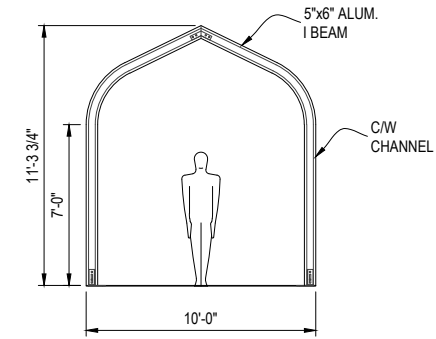

3 SECTION 10'-0" SOUTH VESTIBULE
063.0 1/4"=1'-0"

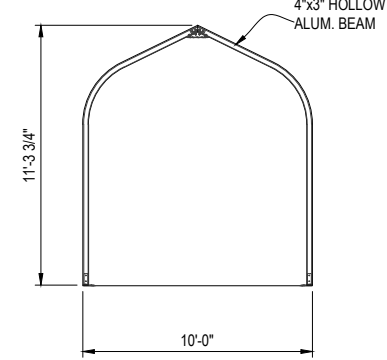


4 SECTION 10'-0" HOOD
063.0 1/8"=1'-0"

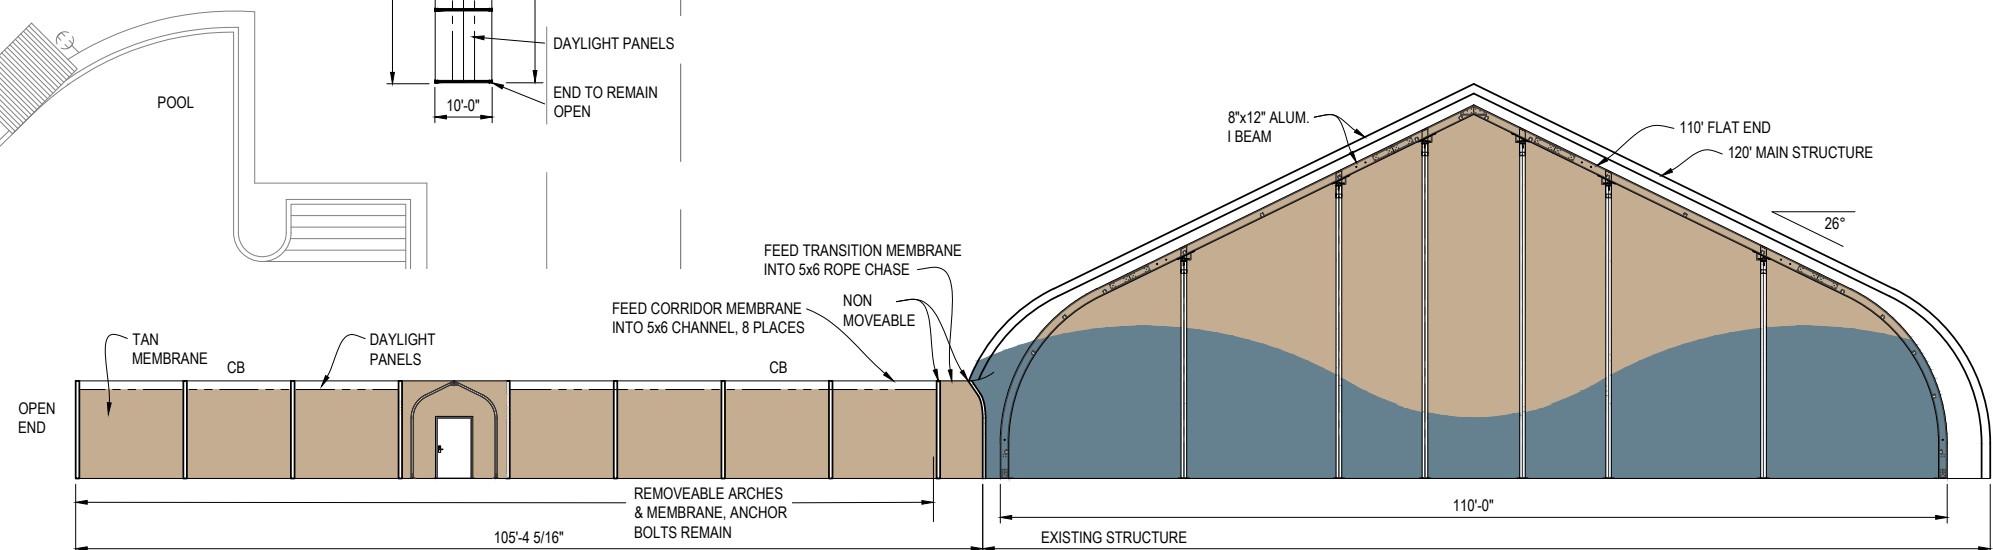

5 RIGHT ELEVATION - NEW CORRIDOR
063.0 3/32"=1'-0"

DRAWING APPROVAL

APPROVED
APPROVED w/ CHANGES NOTED
CONFIRMATION OF DESIGN LOADS AT SITE PER THE LOCAL BUILDING DEPT.
SIGNATURE: _____
DATE: _____ MM/DD/YYYY
BUILDING CODE w/YEAR: _____
WIND LOAD: _____ RISK: _____
SNOW LOAD: _____



GENERAL NOTES:

- ALL PERSONNEL DOORS C/W PANIC HARDWARE & HOODS, AS NOTED.
- STRUCTURE TO BE INSULATED WITH FIBERGLASS BATT INSULATION C/W INNER LINER, TO DAYLIGHT PANEL LEVEL ONLY.
- INNER & OUTER MEMBRANE TO BE FINISHED TO CONCRETE USING ALUMINUM FLAT BAR.
- STRUCTURE MEMBRANE MEETS: NFPA 701, CALIFORNIA STATE FIRE MARSHAL, ASTM E84, CANULC-S-109 & CANULC-S-102 SPECIFICATIONS.
- THIS STRUCTURE IS DESIGNED TO SHED/RELEASE SNOW. THE PERIMETER OF THE STRUCTURE SHALL BE KEPT CLEAR.
- WHEN DESIGNING A HEATING, VENTILATION OR AIR CONDITIONING SYSTEM FOR ANY TYPE OF BUILDING, IT IS IMPORTANT TO ENSURE THAT THIS SYSTEM INTAKES MORE AIR THAN IS BEING EXHAUSTED AT ANY GIVEN TIME. THIS PROCESS WILL RESULT IN A POSITIVE PRESSURE BEING MAINTAINED. CONVERSELY, IF NEGATIVE PRESSURE EXISTS WITHIN THE STRUCTURE, IT WILL BE DIFFICULT TO OPEN DOORS AND MOISTURE WILL BE DRAWN INTO THE STRUCTURE.
- ALL INTERIOR WALLS & PARTITIONS (IF APPLICABLE) TO BE FREE STANDING & INDEPENDENT OF SPRUNG STRUCTURE.

KEARNS OQUIRRH PARK
FITNESS CENTER
120.0 x 195.0
CORRIDOR ADDITION
KEARNS, UTAH

REV.	MM/DD/YY	BY	DESCRIPTION
2	07/07/23	MB	REVISE CORRIDOR DETAILS
3			
4			
5			
6			
7			
8			
9			

FLOOR PLAN & ELEVATIONS
DATE: 06/28/2023 DRAWN BY: M. BELL
P23-063.0

SIGNATURE SERIES